

LEGEND

	SIAMESE CONNECTION
	METER
	ALARM
	CHECK VALVE
	GATE VALVE
	DRAIN
	TEE

NOTES


1. PREFERRED LOCATION INSIDE OF BUILDING (MECHANICAL ROOM).
2. IF VAULT IS OUTDOORS DRAIN TO DAYLIGHT.
3. ASSEMBLY MUST BE KEPT DRY.

CITY OF KIRKLAND


PLAN NO. CK- W.32



FIRE PROTECTION
SPRINKLER
ASSEMBLY

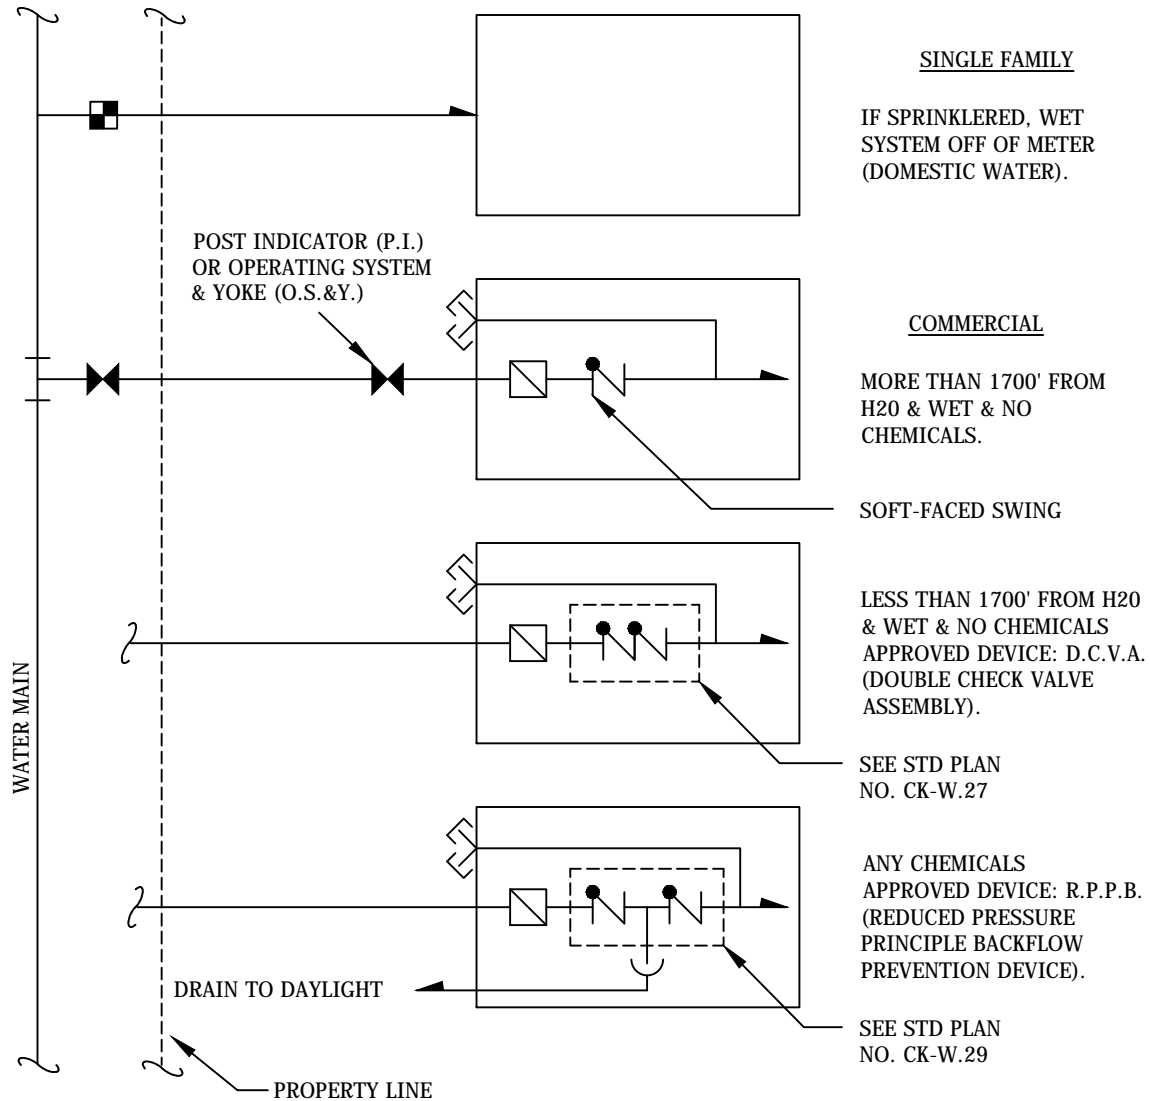

LEGEND

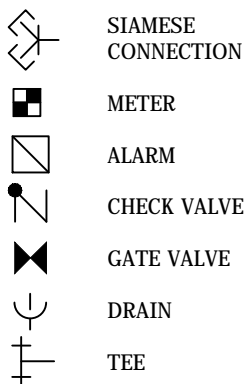

NOTES

1. PREFERRED LOCATION INSIDE OF BUILDING (MECHANICAL ROOM).
2. IF VAULT IS OUTDOORS DRAIN TO DAYLIGHT.
3. ASSEMBLY MUST BE KEPT DRY.

CITY OF KIRKLAND

PLAN NO. CK- W.32



FIRE PROTECTION
SPRINKLER
ASSEMBLY